

**NEW BUILDING SPECIFICATIONS**

30' X 40' X 12.4" POST & FRAME BUILDING


- 1-18" X 8" CONCRETE FOOTINGS (TYP)  
(5301 LB CAP; 5080 LB COLUMN WT)
- ① 2-3'0" X 6'8" 9-LITE FIBERGLASS ENTRY DOORS
- ② 1-9' X 10' INSULATED OVERHEAD DOOR
- ②A 1-18' X 10' INSULATED OVERHEAD DOOR
- ③ 4-36' X 44' THERMALPANE SINGLEHUNG WINDOWS
- ⊗ 3-PLY 2X6 GLULAM POSTS 8' OC (TYP)
- 2X6 TREATED GROUND CONTACT SKIRT BOARD
- 2X4 SPRUCE WALL GIRTS & ROOF PERLINS 24" OC
- 2-2X10 MSR SYP TRUSS CARRIERS @8' SPANS  
(991 PLF CAP; 640 PLF ROOF LOAD)
- TRUSS CARRIER TO POST= 5/8"X4" GRK STRUCTURAL SCREWS  
8 @EA-POST (2 PER SPLICE MIN) 2664 SHEAR RATING
- PRE-ENGINEERED ROOF TRUSSES  
4/12 PITCH, 48" OC, 30--5-5 LOADING
- 2 ROWS 2X4 BOTTOM CHORD TIES (120" OC.)
- 389 LB UPLIFT; 5-12D FACE NAILS=445 LB (PG A4-5)
- 12" EAVE & GABLE OVERHANG W/ VENTED SOFFIT & FASCIA
- 28 GA. G-100 PAINTED STEEL ROOFING & SIDING
- 12" PAINTED STEEL VENTED RIDGECAP

FLOOR PLAN  
SCALE: 3/16" = 1'0"


ALL INFORMATION SHOWN ON THIS DRAWING IS THE PROPERTY OF SHIRK POLE BUILDINGS LLC. THIS DRAWING MAY NOT BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, WITHOUT PERMISSION. DESIGN CHANGES ARE RESPONSIBLE TO VERIFY ALL DIMENSIONS BEFORE CONSTRUCTION.

DRAWN BY: ALS  
REVIEWED:  
REVISIONS:

DATE: 10/26/20  
SITE:  
ELEVATIONS

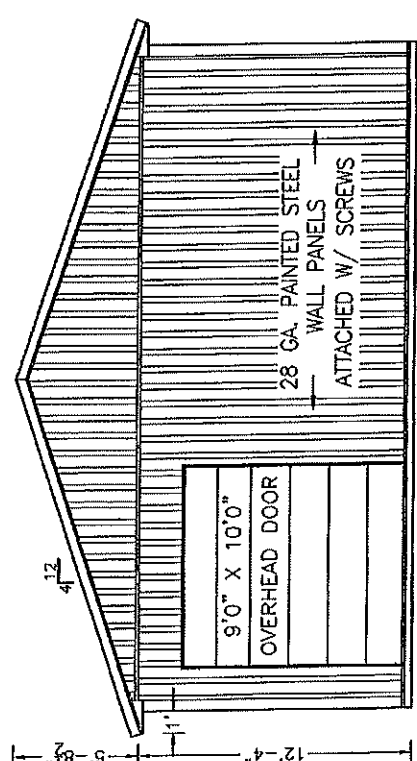


**LEFT ENDWALL**  
SCALE: 1/8" = 1'0"

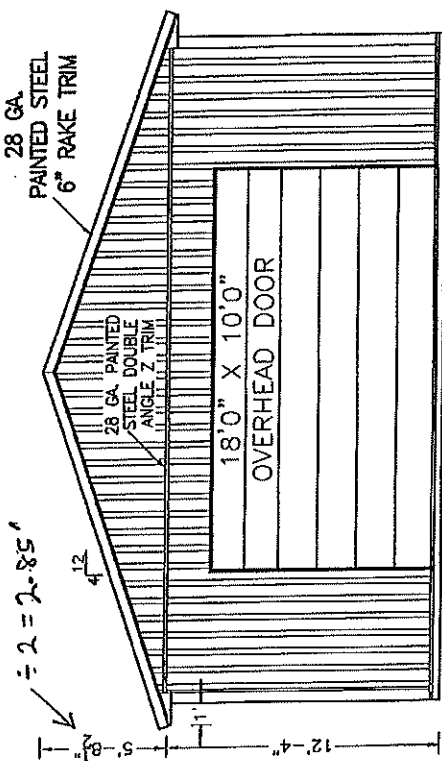


**RIGHT ENDWALL**  
SCALE: 1/8" = 1'0"

mean height = 15.18'












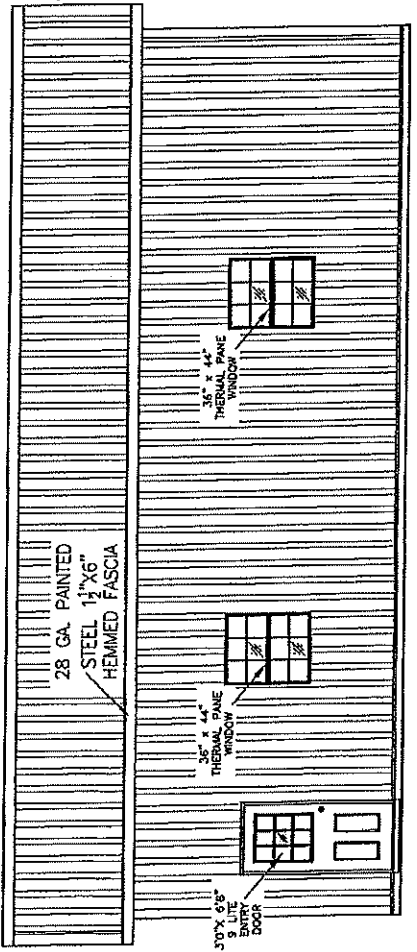


**BACK SIDEWALL**  
SCALE: 1/8" = 1'0"

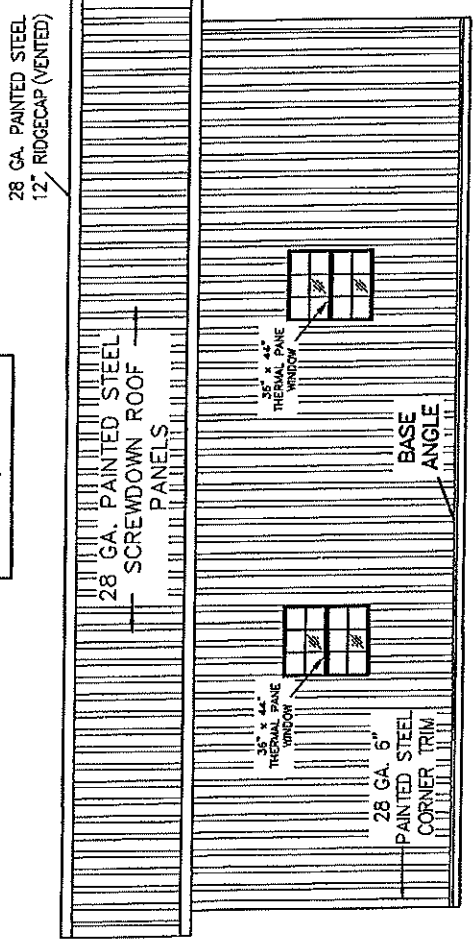

**FRONT SIDEWALL**  
SCALE: 1/8" = 1'0"

2 = 2.85'

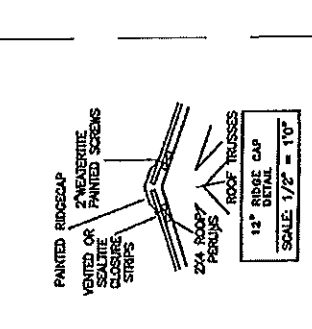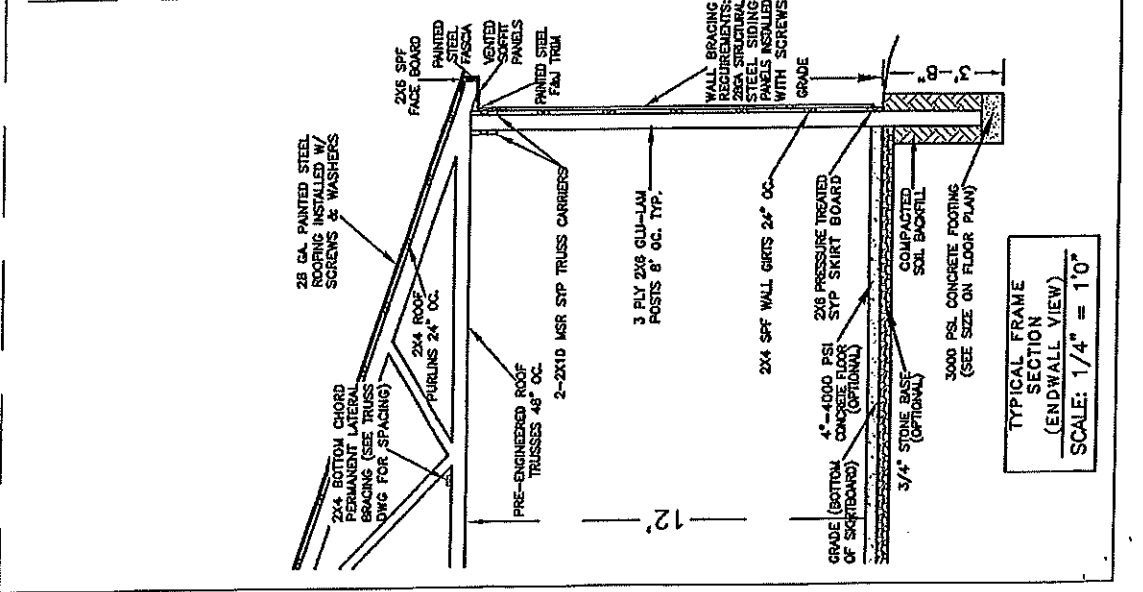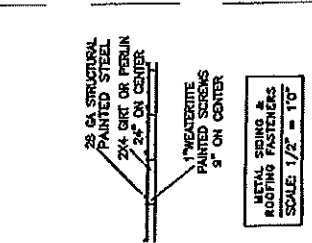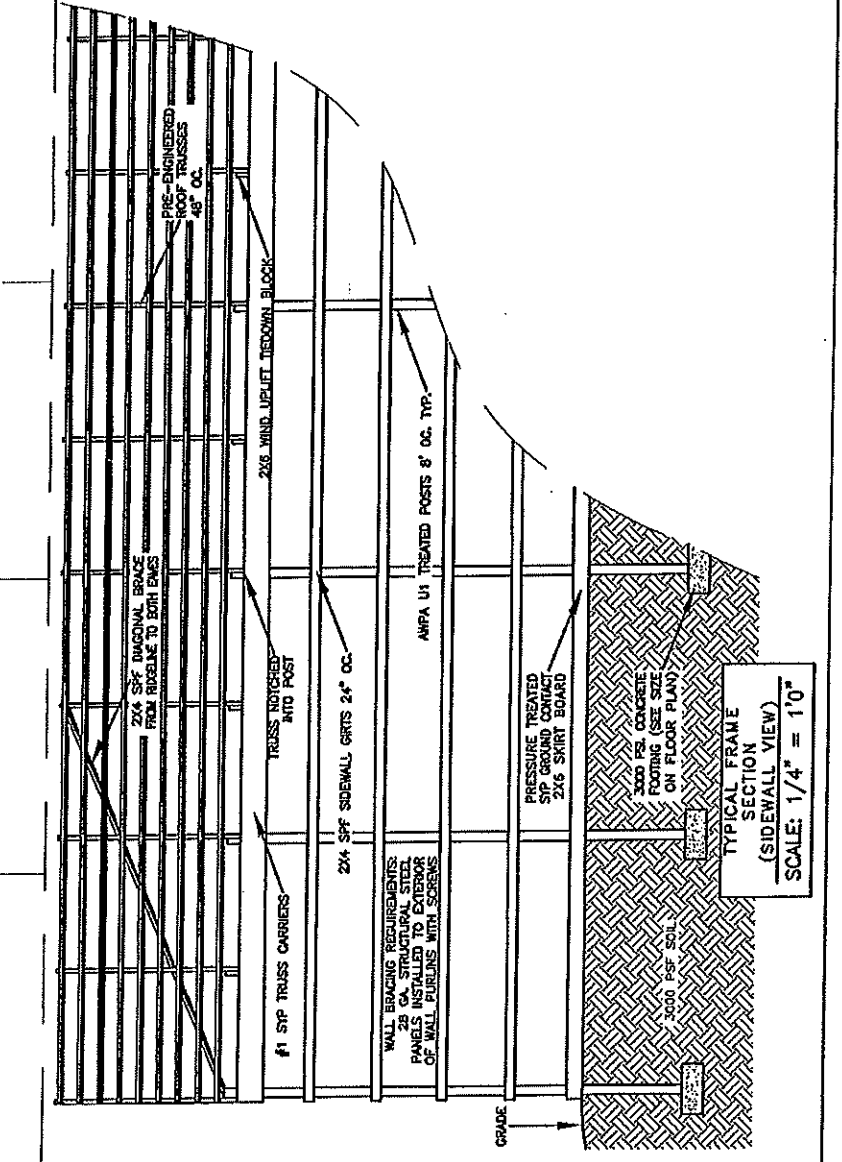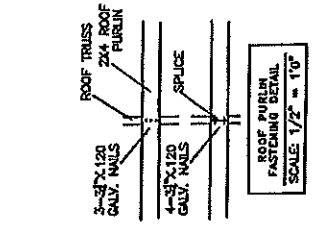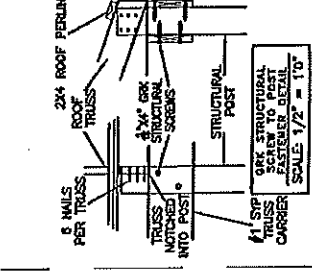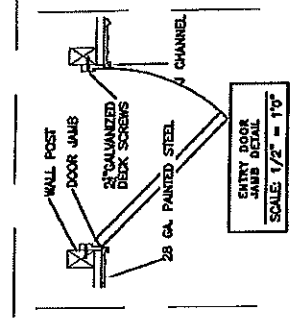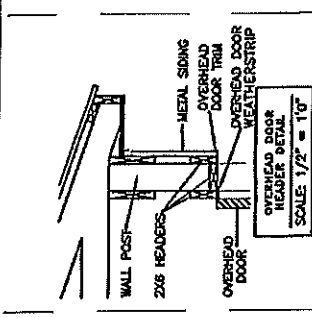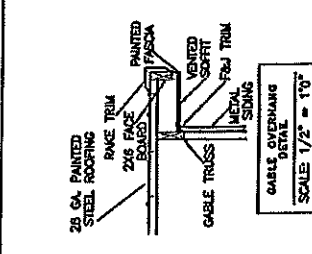

## BUILDING DESIGN NOTES AND DETAILS

- A4.1** GRADING & EXCAVATION  
FINISHED GRADE SHALL BE BELOW FLOOR LEVEL WITH ADEQUATE FALL TO CARRY SURFACE WATER AWAY FROM BUILDING. FOOTINGS SHALL BE CIRCULAR (UNLESS NOTED OTHERWISE) AUGERED TO THE DEPTH AND DIAMETER SPECIFIED, WITH ALL LOOSE FILL REMOVED BEFORE CONCRETE FOOTING MATERIAL IS PLACED.
- A4.2** FOOTINGS  
STANDARD DEPTH FOR FOOTING EXCAVATION IS 44" FROM FINISH FLOOR HEIGHT FOOTINGS SHALL BE A MINIMUM OF 36" DEPTH FOR FROST PROTECTION OR; LOCAL BUILDING CODE DEPTH REQUIREMENTS FOR FROST PROTECTION WILL BE FOLLOWED. DRY MIX CONCRETE HYDRATED IN-SITU WILL BE USED UNLESS OTHERWISE SPECIFIED.
- A4.3** FRAMING  
LUMBER FOR SIDEWALL GIRTS AND PERLINS SHALL BE #2 SPRUCE OR COMPARABLE LUMBER FOR SKIRTBOARD, POSTS AND BEAMS SHALL BE #2 OR BETTER SOUTHERN YELLOW PINE. TIMBERVALUES FOR 3 PLY 2X6 GLU-LAM : FB=2150, FC=2050. LUMBER FOR TRUSS CARRIERS SHALL BE #1 OR BETTER SOUTHERN YELLOW PINE. ALL GROUND CONTACT LUMBER SHALL BE TREATED TO AWPA U1-09 (COMMODITY SPECIFICATION A, USE CATEGORY 4B AND SECTION 5.2) AND ASAE(ASABE)EP559. 60 CCA MINIMUM AND SHALL BEAR AN ACCREDITED LABEL USING #1 OR BETTER STP.
- A4.4** ROOF TRUSSES  
ROOF TRUSSES SHALL BE PRE-ENGINEERED, GROUND SNOW LOAD, DRIFT LOAD, COLLATERAL LOAD, AND WIND LOAD ARE TO BE IN ACCORDANCE WITH BUILDING CODE. TRUSS ERECTION AND BRACING SHALL BE PROVIDED ACCORDING TO MANUFACTURERS SPECIFICATIONS. BOTTOM CHORD OF TRUSS SHALL HAVE PERMANENT LATERAL BRACING OF 120" OC. OR AS REQUIRED PER ROOF TRUSS DESIGN. THE DESIGN PROFESSIONAL OF RECORD HAS REVIEWED THE PRE-ENGINEERED ROOF TRUSS DRAWINGS AS PER REQ.11.1 & IBC 107.3.4.1 AND THEY COMPLY WITH THE STRUCTURAL DESIGN REQUIREMENTS.
- A4.5** PRIMARY ROOF TRUSSES  
PRIMARY ROOF TRUSSES SHALL BE CONNECTED TO THE SIDE OF THE STRUCTURAL POSTS AND INTERMEDIATE ROOF TRUSSES SHALL BE CONNECTED TO THE STRUCTURAL HEADER WITH UPLIFT BLOCKS WITH A SUFFICIENT NUMBER OF FACE NAILS TO OFFSET THE WIND UPLIFT FACTOR AND LATERAL LOADS NOTED ON THE ROOF TRUSS DRAWING IN ACCORDANCE WITH IBC SECTION 2304.9.1, 2308.10.1, AND 2308.10.6
- A4.6** EASTENERS AND FRAMING CONNECTIONS  
STRUCTURE COMPLIES WITH ASAE(ASABE) EP-84 DIAPHRAM DESIGNS & ACTIONS FOR METALCLAD BUILDINGS, IBC WIND BRACING REQUIREMENTS, IBC CONSTRAINED/ UNCONSTRAINED POST REQUIREMENTS & POST TO FOOTING CONNECTION. ALL FRAMING CONNECTIONS SHALL BE OF A SIZE AND DESIGN TO MEET DESIGN LOADS SPECIFIED. NAILS USED IN .60 ACG/CCA TREATED WOOD SHALL BE 12D HOT DIPPED GALVANIZED; ASTM A 153 PLATED 1.2 MIL SCREWS, AND A 65 CLASS G 185 HARDWARE. THE MINIMUM AMOUNT OF 12D NAILS IN 2X4 ROOF PERLINS IS 2. THE MINIMUM AMOUNT OF 12D NAILS IN 2X4 WALL GIRTS IS 3. THE MINIMUM # OF 12D NAILS IN 1 1/2" STRUCTURAL TIMBER IS 1 PER 2" BOARD WIDTH. TRUSS CARRIER CONNECTION TO POST: 5/8" x 4" CRK RSS STRUCTURAL SCREWS. SCREW VALUES: LATERAL DESIGN VALUE=333 LB, TENSILE STRENGTH=139,000 PSI, PULLOUT=2644 LBS. HEAD PULL THROUGH=825 LBS, MIN. BENDING ANGLE=35°
- A4.7** METAL SIDING AND ROOFING  
METAL SIDING AND ROOFING SHALL BE INSTALLED WITH #9 WOODGRIP, 3/4" HEX HEAD, METAL AND RUBBER WASHERED GALVANIZED COLOR MATCHING SCREWS. FASTENERS SHALL COMPLY WITH THE ROOFING & SIDING MFG'S REQUIREMENTS. METAL SIDING AND ROOFING SHALL BE WARRANTED #1 GRADE 80,000 PSI MIN. TENSILE STRENGTH CORRUGATED 28 GAUGE PAINTED ABM STEEL PANELS GALVANIZED TO A MINIMUM OF G-100. METAL SIDING AND ROOFING SHALL BE TRIMMED WITH CORRECT FLASHINGS AT EXPOSED EDGES, ROOF ENDS, CORNERS, DOORS, WINDOWS AND RIDGES, EXCEPT; BOTTOM EDGE OF STANDARD ROOFING MATERIALS.

A4.8

CONCRETE FLOOR (OPTIONAL)

FIBER REINFORCED 4000 PSI CONCRETE SLAB ON GRADE OVER COMPACTED BASE. SLAB WILL BE POURED AGAINST SKIRTBOARD WITH NO TURN DOWN.

## STRUCTURAL DESIGN PARAMETERS

BUILDING USE= STORAGE

USE GROUP=U

RISK CATEGORY 1

EXPOSURE CATEGORY= C

HEIGHT & AREA LIMITATIONS=5B UNPROTECTED

OCCUPANCY LOAD=AS PER DESIGN

TOTAL NUMBER OF FLOORS= 1

TOTAL FLOOR AREA (50 FT)=1200

BUILDING VOLUME (CU FT)=17,600

STRUCTURE IS DESIGNED FOR ASCE 7-10 ULTIMATE WIND SPEED, VULT=115 MPH

(3 SECOND GUST) AND NOMINAL DESIGN WIND SPEED VASD=91 MPH.

SOIL BEARING CALCULATIONS ARE BASED ON SOIL BASE CONDITION 3000 PSF

@48" BELOW GRADE UNLESS NOTED OTHERWISE.

30 PSF(LIVE) MIN.SNOW; 5 PSF TOP CHORD & 5 PSF BOTTOM CHORD LOADS.

A4.10

## APPLICABLE BUILDING CODES

THESE PLANS ARE DESIGNED IN ACCORDANCE WITH THE FOLLOWING BUILDING CODES:

2018 IBC CODE NJ EDITION (N.J.A.C. 5:23-3.14) AND ASCE 7-16

A4.11

## DESIGN REFERENCES:

NFPA GUIDELINES FOR POST & FRAME CONSTRUCTION

AMERICAN WOOD COUNCIL 2018 NDS & WFCM 2018 FOR WOOD CONSTRUCTION

SOUTHERN PINE COUNCIL (JOISTS & RAFTERS/ HEADERS & BEAMS)

AMERICAN NATIONAL STANDARDS (ANSI 117-2010)

SOUTHERN BUILDING CODE CONGRESS (SSTD10)

ASCE MINIMUM DESIGN LOADS FOR BUILDINGS AND OTHER STRUCTURES

GEORGIA PACIFIC ENGINEERED LUMBER (EDITION 10)

A4.12

## WARRANTY NOTES

ANY DESIGN MODIFICATION OR ANY STRUCTURAL MODIFICATION BEFORE, DURING, OR AFTER CONSTRUCTION TO BUILDING BY ANY PERSON(S) OR COMPANY OTHER THAN WORK PERFORMED OR APPROVED BY SHIRK POLE BUILDINGS LLC WILL VOID ANY AND ALL WARRANTIES PROVIDED BY MANUFACTURERS AND/OR SHIRK POLE BUILDINGS LLC. SUCH DESIGN MODIFICATIONS AND/OR STRUCTURAL MODIFICATIONS INCLUDE:

DRILLING, REMOVING, CUTTING, SAWING, SPLINTERING OR DAMAGING ANY

STRUCTURAL MEMBERS INCLUDING FOOTINGS, POSTS, GIRTS, BEAMS, TRUSSES,

PERLINS, PANELS, WINDOWS, DOORS, NAILS, SCREWS, AND BOLTS.

SUCH DESIGN MODIFICATIONS AND/OR STRUCTURAL MODIFICATIONS ALSO INCLUDE:

ADDING ADDITONS, SNOW DRIFT LOAD FROM ADDITIONS, LEAN-TO'S, ATTIC

STORAGE, CHAIN HOISTS, OPENINGS, SKYLIGHTS, ROOF VENTS, AND LOUVERS.

SHIRK POLE BUILDINGS LLC WILL NOT BE LIABLE FOR ANY FAILURES RESULTING

FROM THOSE MODIFICATIONS LISTED ABOVE, OR FROM ANY OTHER MODIFICATIONS

NOT APPROVED BY A CERTIFIED ENGINEER.

A4.13

## CONTRACTOR LICENSING

NJ 13VH02705800 EXPIRES 3/31/2021



OWNER

JOE MERWIN  
1321 CAMDEN AVE  
WHITTING, NJ 08759

ALL INFORMATION SHOWN ON THIS DRAWING IS THE PROPERTY OF SHIRK POLE BUILDINGS LLC. THIS DRAWING MAY NOT BE REPRODUCED WITHOUT PERMISSION FROM SHIRK POLE BUILDINGS AND SHALL BE THE RESPONSIBILITY OF THE ARCHITECT BEFORE CONSTRUCTION.

DRAWN BY: ALS

REVIEW:

REVISIONS:

DATE: 10/26/20

SITE:

DETAILS

A.4